PORT • A • COOL CYCLONE

portable evaporative cooling units

QUICK SETUP SHEET

1

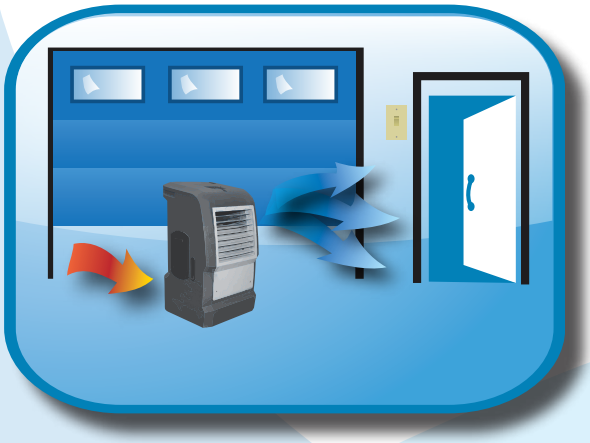

IF USING INDOORS

- Place back of unit near a slightly opened window or door.
- A window or door on the opposite side of the room should be left slightly open.

CAUTION: Do not run pump when water tank is dry.

2

FILL WITH WATER

- Fill manually until water gauge shows the tank is full.

Scan the QR code for more information.

3

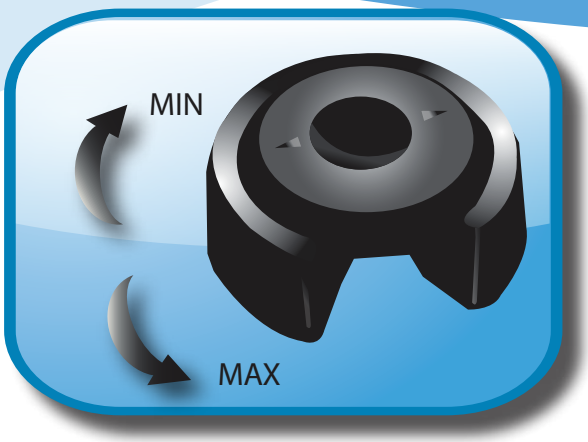

Initially, there may be some odor emitted from the pads. This disappates after 1-3 weeks

ADJUSTING WATER FLOW FOR OPTIMAL COOLING

- Turn pump on so water is flowing over pads
- Turn fan on and run for 5 minutes
- Adjust water flow to achieve narrow dry streaks on pads
- Turn water valve to the right if no dry streaks are present
- Turn water valve to the left if large areas of dry pad are present
- Allow 5 minutes between adjustments

The water flow valve on each unit is set at max flow. Adjust as needed before use.

For more information, please see the owner's manual included with your Port-A-Cool® unit
Call (936) 568-5651 or visit www.port-a-cool.com/cycloneproducts.html

PORT • A • COOL CYCLONE

unidades evaporativas portátiles

INSTALACIÓN RÁPIDA

1

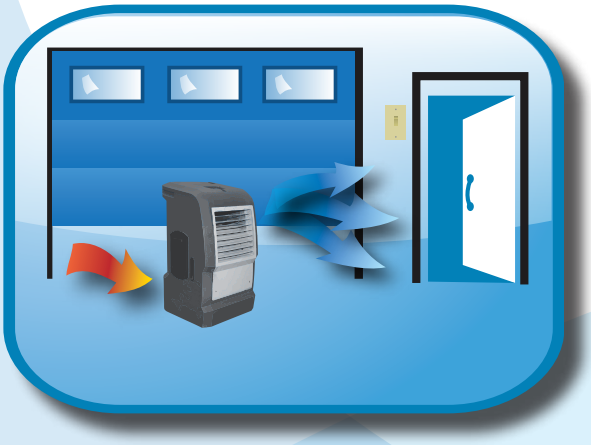

SI SE USA EN INTERIORES

Para la circulación óptima y mejor enfriamiento, coloque el lado posterior de la unidad cerca de una ventana o una puerta abierta. Una ventana o puerta en el lado opuesto del cuarto debe dejarse ligeramente abierta.

PRECAUCIÓN: No haga funcionar la bomba cuando el tanque de agua está vacío.

2

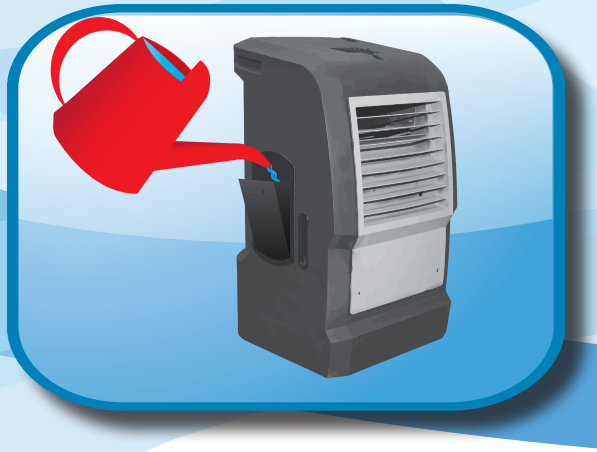

LLENE EL TANQUE CON AGUA

Conecte la unidad a una manguera de jardín o llene el tanque manualmente hasta que esté lleno y conecte a un contacto de corriente eléctrica estándar.

Escanee el código QR para más información.

3

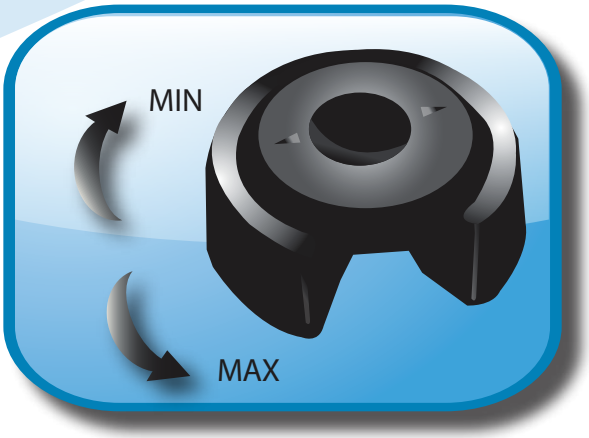

AJUSTE DE LA VÁLVULA DE FLUJO DE AGUA PARA UN ENFRIAMIENTO ÓPTIMO

Encienda la bomba y asegúrese que el agua moja los paneles de papel. Encienda el ventilador y permita que trabaje por 5 minutos. Observe los paneles de papel, ajuste el flujo de agua con la válvula que se encuentra a un costado de la unidad, debe observar algunas áreas "secas" en los paneles para un enfriamiento óptimo, si no es así, cierre la válvula para que fluya menos agua por lo paneles, si observa demasiadas áreas "secas", abra la válvula para que el flujo de agua sea mayor.

Al inicio los paneles pueden despedir algún olor. Este desaparece después de 1 a 3 semanas de

Espere 5 minutos entre los ajustes para observar progreso.

Para más información, por favor mire el manual de usuario incluido con su unidad Cyclone®.